

Watson-Marlow Pumps Group
Telephone +44 (0) 1326 370370
Fax +44 (0) 1326 376009
E-mail: info@watson-marlow.co.uk
www.watson-marlow.com







Members of the Spirax Sarco Engineering Group



The information contained in this document is believed to be correct, but the Watson-Marlow Pumps Group accepts no liability for any errors it contains, and reserves the right to alter specifications without notice.


WARNING
 This product is not designed for use in, and should not be used for, patient-connected applications.

PB0328/10

	403U/L2 - 50rpm 405U/L2 - 200rpm		+5C, +41F
	<70dBA@1m		+40C, +104F
	403U/L2 - 2kg 405U/L2 - 3.5kg		-40C, -40F
			+70C, +158F



403U/L2, 405U/L2




David Cole
 David Cole, Managing director






2006/42/EC, 2004/108/EC,
 2006/95/EC, BS EN60529 (IP21),
 2006/42/EC



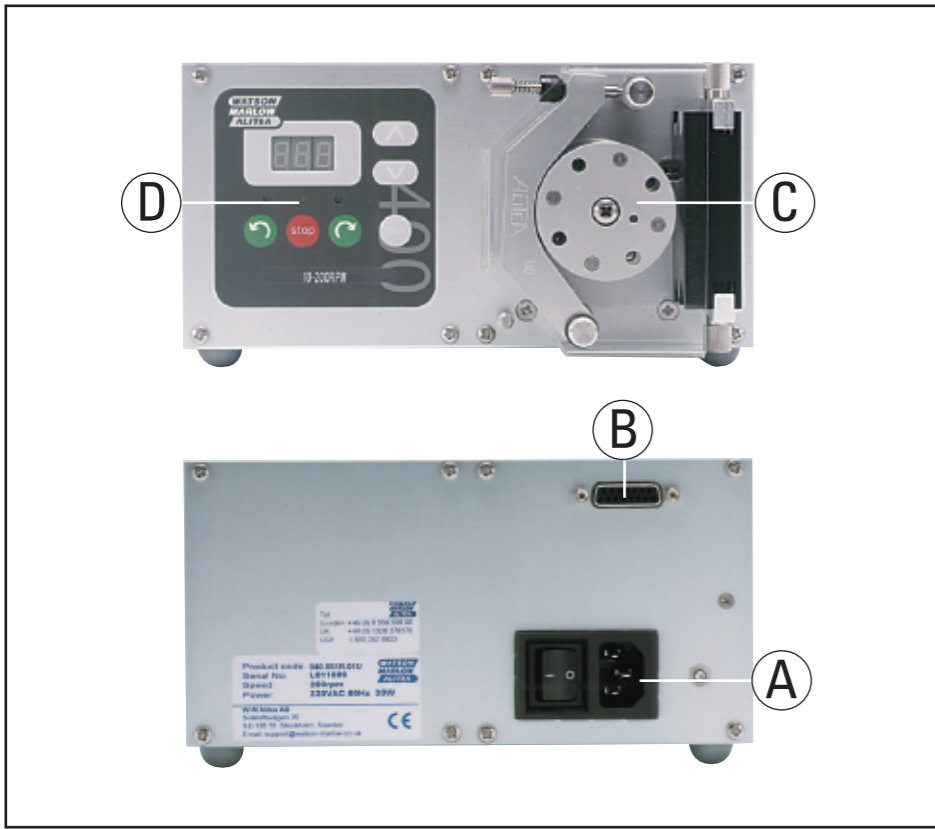

- A**
- 040.3*1L.02*U = 240V/1/50/60Hz
 - 040.3*1L.02*E = 230V/1/50/60Hz
 - 040.3*1L.02*A = 110V/1/60Hz
 - 040.5*1L.02*U = 240V/1/50/60Hz
 - 040.5*1L.02*E = 230V/1/50/60Hz
 - 040.5*1L.02*A = 110V/1/60Hz

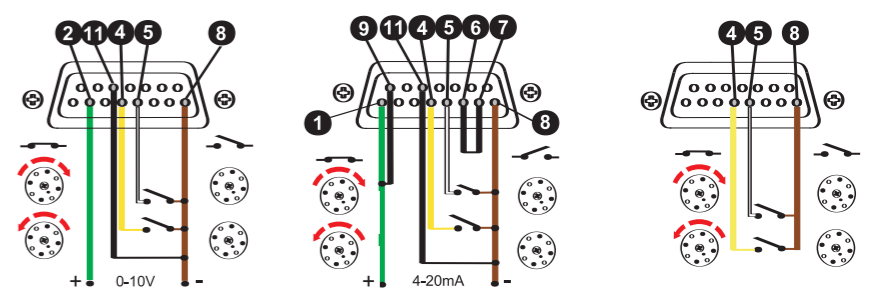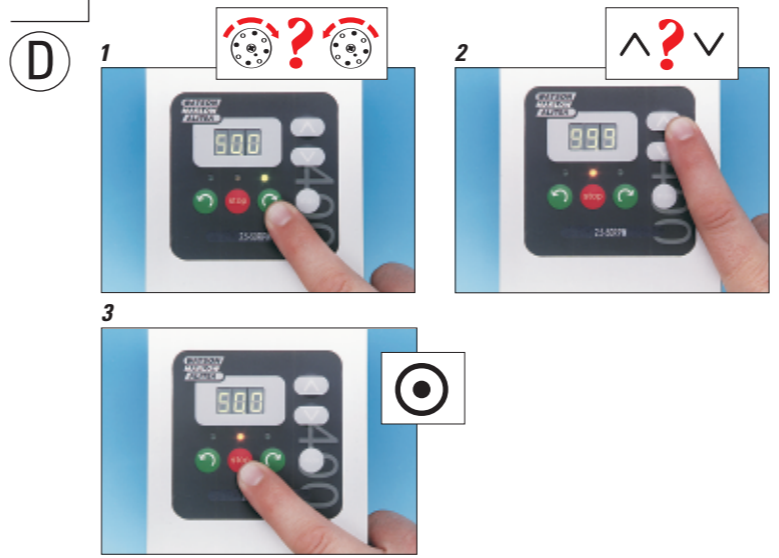

403U/L2 405U/L2

