

**Watson-Marlow Pumps Group**  
**Telephone +44 (0) 1326 370370**  
**Fax +44 (0) 1326 376009**  
**E-mail: [info@watson-marlow.co.uk](mailto:info@watson-marlow.co.uk)**  
**[www.watson-marlow.com](http://www.watson-marlow.com)**








Members of the Spirax Sarco Engineering Group



The information contained in this document is believed to be correct, but the Watson-Marlow Pumps Group accepts no liability for any errors it contains, and reserves the right to alter specifications without notice.


**WARNING**  
 This product is not designed for use in, and should not be used for, patient-connected applications.

PB0384/10

	360rpm		+5C, +41F
	<85dBA@1m		+40C, +104F
	720+720R(E) 25kg 55lb 720+720R(E)/R(E)X 34.5kg 69lb		-40C, -40F
			+70C, +158F



## 720Bp pumps

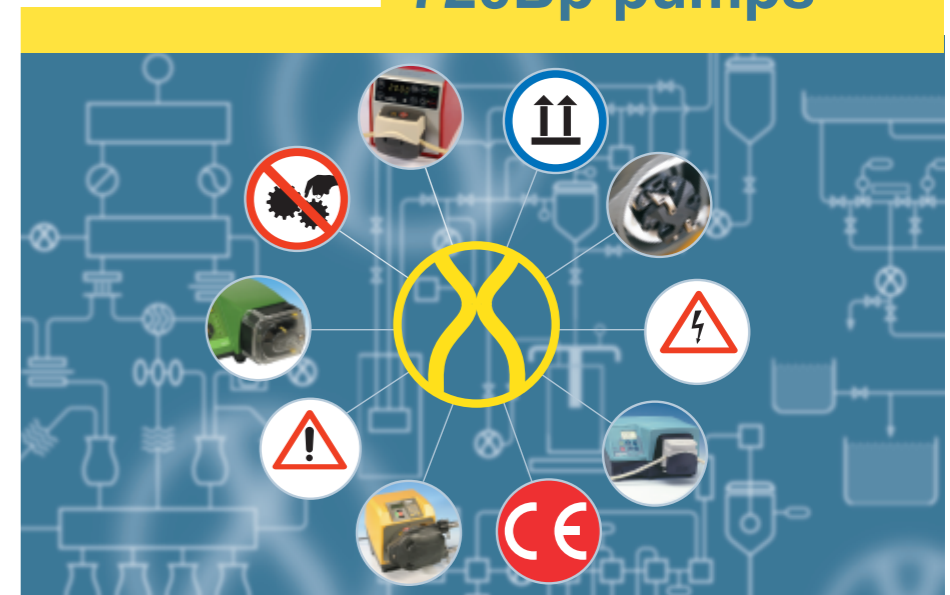

*David Cole*  
 David Cole, Managing director



2006/42/EC, 2004/108/EC



